

PERMIT FOR CONSTRUCTION OF SUBSURFACE SEWAGE DISPOSAL SYSTEM

Issued to: <u>Thos Earl Sledge</u> Owner, Developer, Contractor, Installer, Etc.	REGION <u>5</u>	COUNTY <u>94</u>	ID-NUMBER	DATE <u>1/10/80</u>
To be constructed by <u>Greg Daniels</u> (Installer)	STAFF <u>007</u>	INSTALLATION: <input checked="" type="checkbox"/> 1. New Installation <input type="checkbox"/> 2. Repair to Existing System		
Construction of a subsurface sewage disposal system is hereby authorized at: <u>6280 Orms Road FRANKLIN</u> (No. and street; Subdivision name and lot no.) <u>3704</u>	Type of System: <input type="checkbox"/> 1. Standard <input checked="" type="checkbox"/> 3. Chapter 301 <input type="checkbox"/> 2. Alternating <input type="checkbox"/> 4. Other			
Such a system shall consist of a septic tank of <u>1000</u> gals. with <u>480</u> linear feet in <u>4-5</u> trenches, <u>36</u> inches wide, and <u>24</u> deep or <u>see note below</u>	For: <input checked="" type="checkbox"/> 1. Residential: No. B/R <u>7</u> <input type="checkbox"/> 2. Commercial/Industrial; Gal/Day _____			
	Evaluation based Upon: <input checked="" type="checkbox"/> 1. Soil Typing by Soil Scientist <input type="checkbox"/> 2. Soil Percolation Tests <input type="checkbox"/> 3. Other			
	Permeability Rate <u>75</u>			


MAP 115
PAR. 12.02

The recipient of this permit agrees to construct or have constructed the system in accordance with the rules and regulations under the authority of TCA 53-2054. The recipient must notify the local health authority when the system is ready for inspection. If any part of system is covered before being inspected and approved, it shall be uncovered by the recipient of the permit at the direction of the local health authority.

Thos Earl Sledge Date 1/23/80
(Signature of Recipient-Owner, Developer, Contractor, Etc.)

Issued at _____, Tennessee in the County of Union

By WCHA Date 1/23/80
(Local Health Authority)

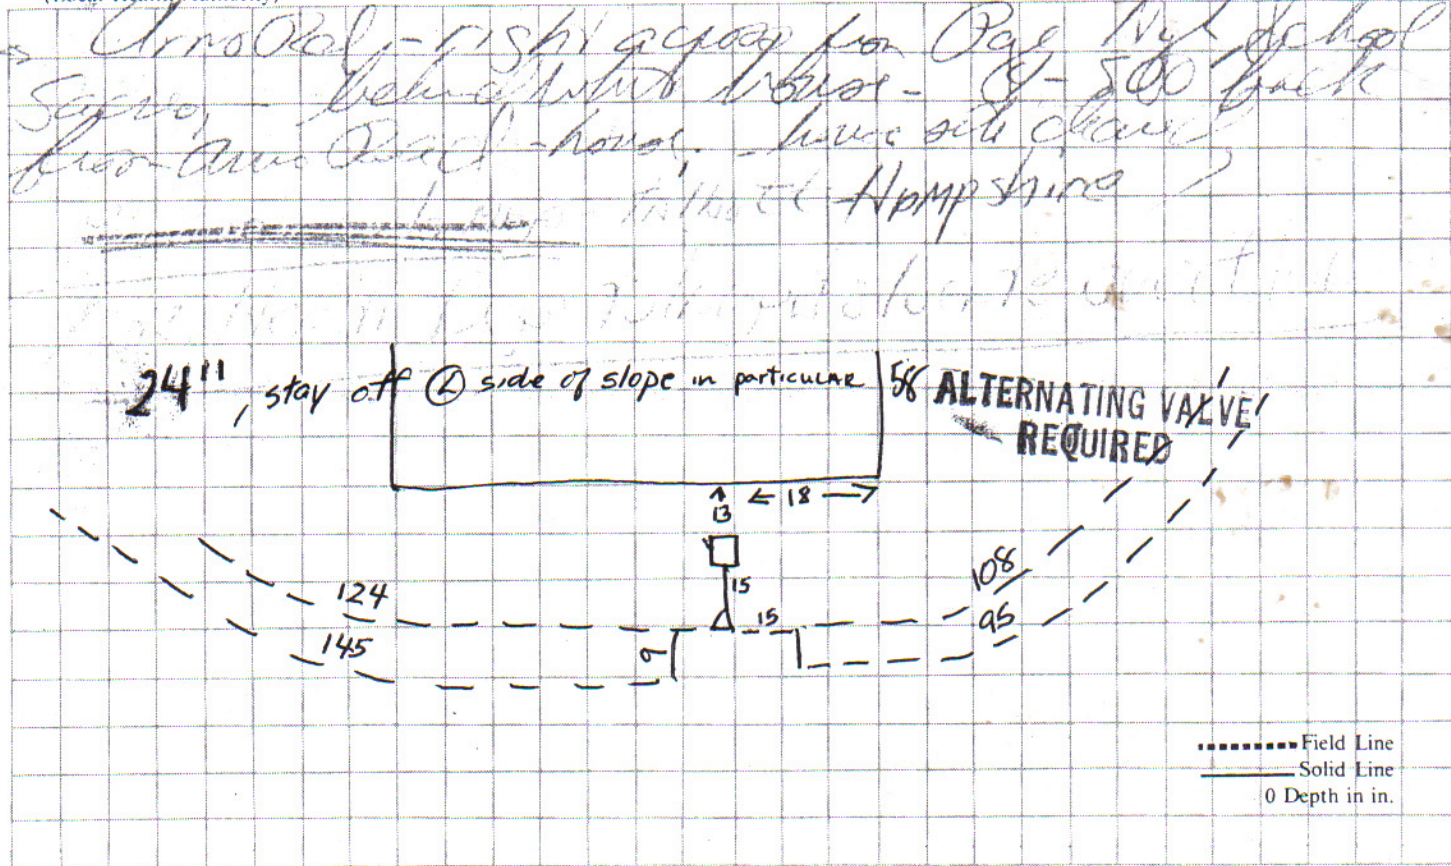

Inspected By D Hoover Local Health Authority
Date 4-1-80

Construction Approval: 1. Yes 2. No

No. of Visits: 4 Time 050